

□□ □□ □□ **12V 5A** □□□□ □□□□ □□□□ □□ □□
□□ □□□□

5A □□ □□ □□ □□
□□□□ □□ □□ □ □□ □□ □□□□ □□□□□□.
□ □□ □□ □□□□ □□□□, □□□□ □□ □□□□ □□, □□ □□ □□□□ □□
□□ □□□□ □□□□□□ □□□□□□.

-
-
-
-
-
-
-



說明

- 1 : COM 端子, 電壓 DC12V, 電流 (0-15 mA, 3 線);
- 2 : NC 端子, 電壓 DC12V, 電流 (0-15 mA, 2 線, 3 線);



3 : DC12V 電源 端子, 4番 端子, 5番 端子;

4 : 電源 端子 (電源 端子, 端子) 電源 端子 電源 端子 電源 端子 電源 端子 電源 端子 (電源 端子, 端子) 電源 端子 端子 .

5 : 電源 端子 (電源 端子, 端子) 端子, 電源 端子 端子 電源 端子 端子 電源 端子 端子 (電源 端子, 端子) 電源 端子;


6 : 電源 端子 端子 電源 端子 端子 電源 端子 端子 12V 電源 端子 端子



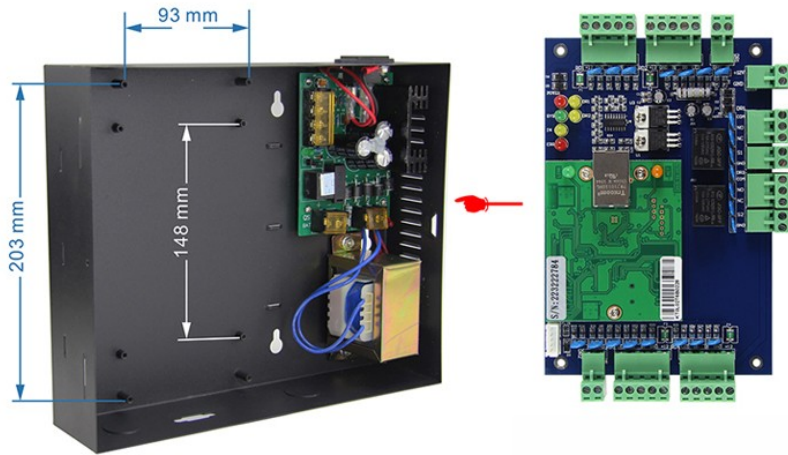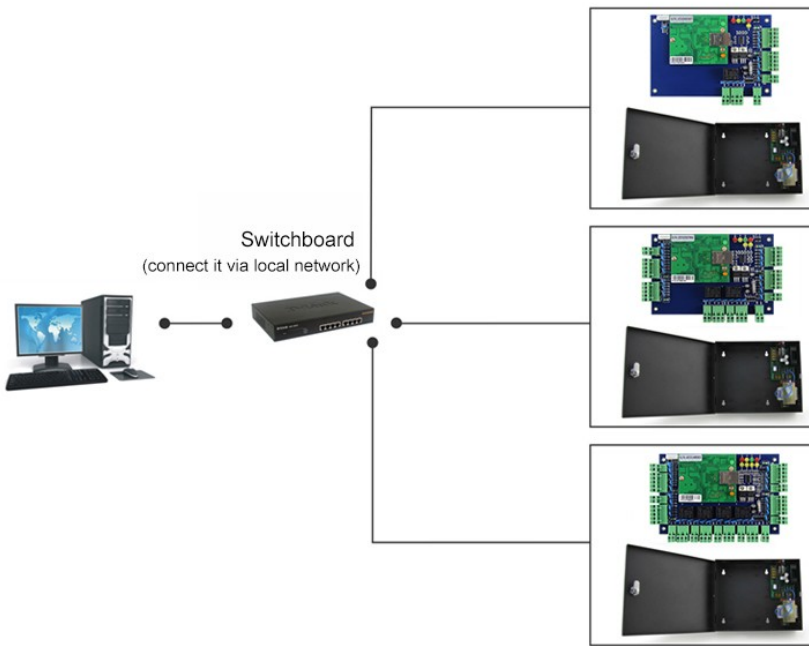

Kindly remind:

All network control board must configure with access power supply.
1 board for 1 power supply

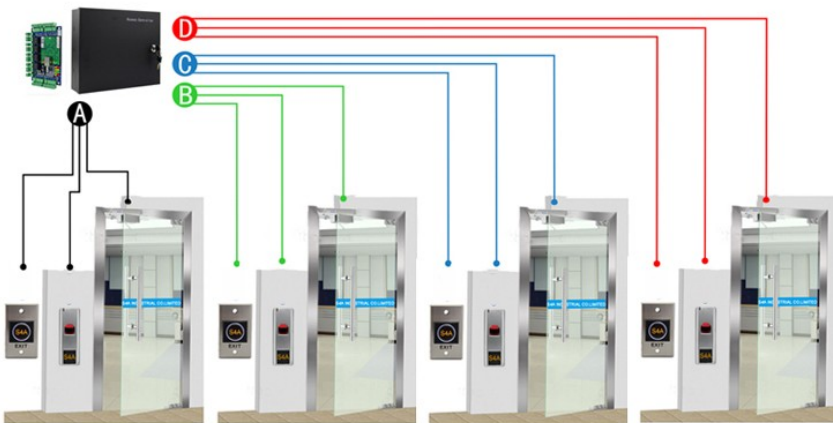

ACM-WEG04

Four doors 1 way: Control 4doors (Enter by Swipe cards and Exit by Push button)

Scope of Application



Company



Hospital



Hotels



Logistics



Port



Financial



Government



Factory



Aviation



School



00 000 000 000 000 00 0 000 000 00 00000.
 00 000 000 000 000 00 0000 00000.
 000 000 0 00 00 000 00 0 0000.



EXW

FCA FOB

CIF CFR



00 00 (00 00 00)

000 2000 000 000 RFID 000 000 0 00 0 00000.
 000 00 00 000 00 00 000 0 00 000, 000 00 00
 00 00 / 000 000 000 0000 000 0 00 0000. 000
 000 CO, FTA, 00 F, Form E ... ECT 00 000 00
 0 000 000 000 0000 00 0 0 0000. 000 000 000
 00 0000 000 00000. EXW, FOB, FCT, CIF, CFR
 ... 00 000 000 00 000000. 000 00 0 000000 000
 000 0000 0 0 0000.